


BELZONA REPAIRS BROKEN HYDRO ELECTRIC TURBINE RUNNER

ID: 4674

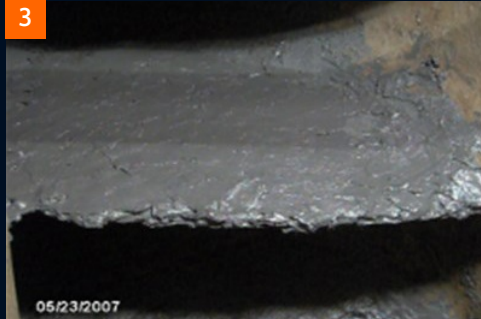

PROBLEM

Loss of balance and horsepower.

APPLICATION SITUATION

Wicket gate came loose and fell into turbine breaking three blades on runner.

APPLICATION METHOD

Application was carried out in accordance with the Belzona Know-How System Leaflets CEP-1 & CEP-3. Expanded metal was tack welded in place before rebuilding with Belzona® 1311. Complete runner was coated with Belzona® 1311 and Belzona® 1341 was applied on top to improve fluid flow efficiency.

BELZONA FACTS

The efficiency gain was so profound, that the customer was able to reduce the water setting from 70% to 62% without changing the power output from the runner, maintaining the 500 kW output. Using less water, the water behind the dam lasts longer, keeps the turbine running longer, resulting in increased revenue across a year. Belzona solution cost 9.2% of the conventional replacement by repairing the turbine instead of tearing it down and sending it out to be repaired. While the conventional repair would take 10 weeks of downtime, Belzona refurbishment took 2 weeks. The customer's payback period on this repair was 3 months. Three years later and the turbines still have good horsepower with the runner blades still intact.

INDUSTRY

Power

LOCATION

Hydro Electric Plant, USA

APPLICATION DATE

May, 2007

PRODUCTS

Belzona 1311 (Ceramic R-Metal) Belzona 1321 (Ceramic S-Metal) Belzona 1341 (Supermetalgilde)

SUBSTRATE

Cast steel

PHOTOS

Broken runner blade Expanded metal tack welded Blades rebuilt with Belzona 1311 Completed application after coating runner

For more examples of Belzona Know-How in Action, please visit khia.belzona.com

Belzona products are manufactured under an ISO 9001 Registered Quality Management System.

www.belzona.com

